

LD-F, LD-W Leak Detector 9-30VAC/DC Power, Isolated NO switch output




IMPORTANT WARNINGS

- Only qualified trade installers should install this product
- This product is not intended for life-safety applications
- Do not install in hazardous or classified locations
- The installer is responsible for all applicable codes
- De-energize power supply prior to installation or service

PRODUCT APPLICATION LIMITATION:

Senva products are not designed for life or safety applications. Senva products are not intended for use in critical applications such as nuclear facilities, human implantable device or life support. Senva is not liable, in whole or in part, for any claims or damages arising from such uses.

DIMENSIONS

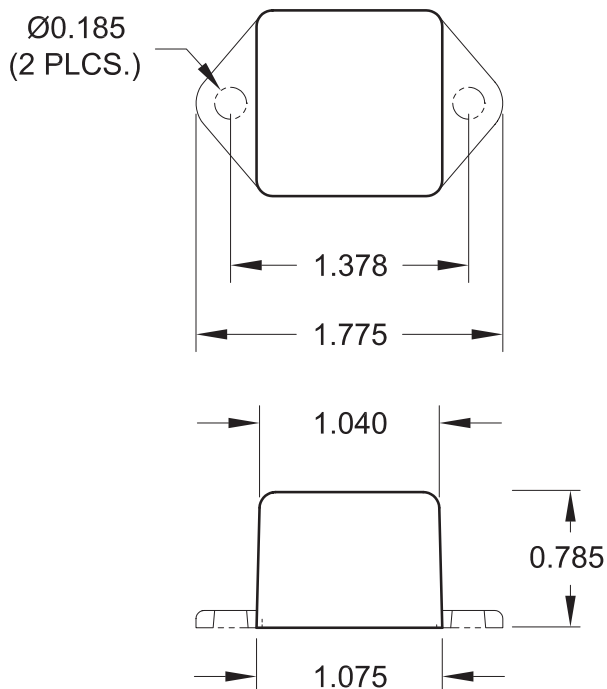

INSTALLATION

1. Install sensor in the area to be monitored such that probe pins will contact collected water.
2. Position with screws or other means.
3. Wire sensor as follows:

RED = Power Supply 9-30VAC/DC
BLACK = Ground/Common

WHITE = N.C. (Form B) Switch
GREEN = N.C. (Form B) Switch

Switch contact is electrically isolated from power supply.

OPERATION

Switch output opens when sensing probe pins are bridged by water, or power is removed.

Water supply must be less than 1,000k (1M) ohms. Nearly all water supplies contain sufficient dissolved minerals to trigger the sensor including: Filtered, Tap, Rain, Condensate, Melted Ice, Detergent, and Salt.

Not suitable for detecting distilled water.

Sensing probes utilize alternating current sensing (even when powered by DC current) to prevent electrolysis and oxidation of the sensing probes.

SPECIFICATIONS

Power Supply	9-30VAC/DC, 50mA Max. Isolated ¹
Output	N.O. Solid State Relay, Isolated
	N.C. when powered, opens when water detected
Output Rating	30VAC/DC, 0.1A (100mA) Max.
Cable Length	15 Ft.
Sensing	Gold plated electrodes
Operating Environment	-20 to 50° C Air / 0-95% RH non-condensing 0 to 50° C submerged
	IPX7 rated

(1) Isolated power supply from earth ground required.