


Manufacturer:	Senva, Inc.	Certificate Number:	P4CAL000139
Model:	P4-0050-BB2XX	Serial Number:	8181CE85
Range:	-0.50 to 0.50 "H2O	Output:	0 to 10 VDC
Calibration Date:	4/8/2021 2:58 PM	Calibrated By:	TN

TEST RESULTS

Applied Pressure ("H2O @ 20°C)	Measured Output (V)	Nonlinearity Error (%FS)
-0.5000	0.0055	-0.1702
-0.3334	1.6393	0.1706
-0.1667	3.3137	0.1071
-0.0000	4.9921	0.0011
0.1666	6.6671	-0.0704
0.3333	8.3404	-0.1226
0.4999	9.9876	0.0844

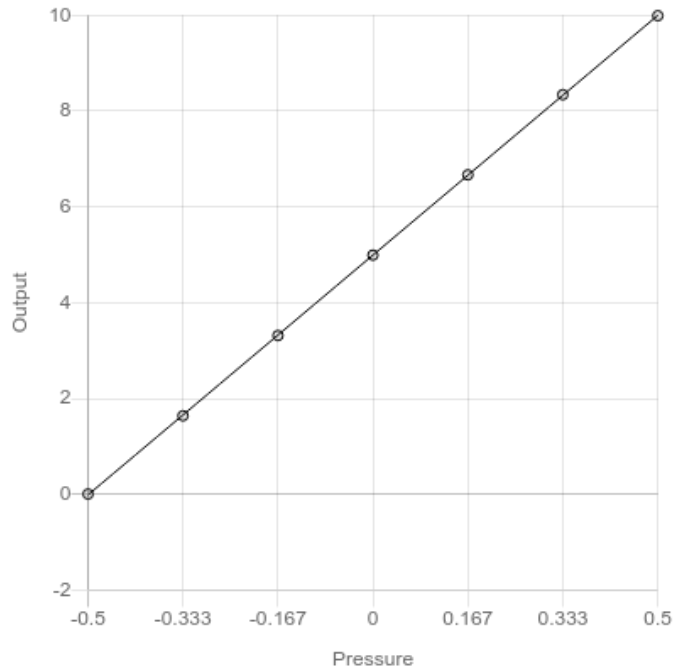

TEST EQUIPMENT

Manufacturer	Model	Serial Number	Last Cal Date	Cal Due Date
Keysight	DAQ970A	MY58001379	6/30/2020	6/30/2021
Fluke	7250LP	70353	10/20/2020	11/20/2021

Resulting Accuracy **0.204%FS** includes non-linearity(BFSL), repeatability, and hysteresis.
 Testing was completed at 75°F (+/- 10°F).
 Senva Inc. certifies that the above certification conforms to ISO 17025 and meets applicable accuracy tolerance requirements.
 All certification equipment is NIST Traceable.

Senva, Inc.
 9290 SW Nimbus Ave.
 Beaverton, OR 97008
 Toll Free: (866) 660-8864
 Fax: (503) 296-2529
 sales@senvainc.com
 www.senvainc.com

